


1/2" EXPANSION JOINT MATERIAL, FULL DEPTH ON PIPE CENTERLINE

CLASS B BEDDING, SEE 71B-5

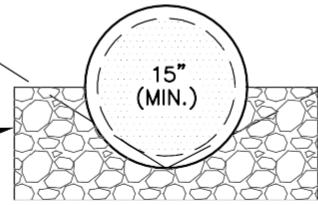


EXISTING DITCH GRADE

NOTES:

1. SEE CITY SPECIFICATIONS, SECTION 7.0 REGARDING PIPE MATERIAL.
2. HDPE SHALL BE INSPECTED DURING INSTALLATION TO VERIFY STONE BEDDING. (RCP AND CPP DO NOT REQUIRE STONE BEDDING.)

SECTION A-A

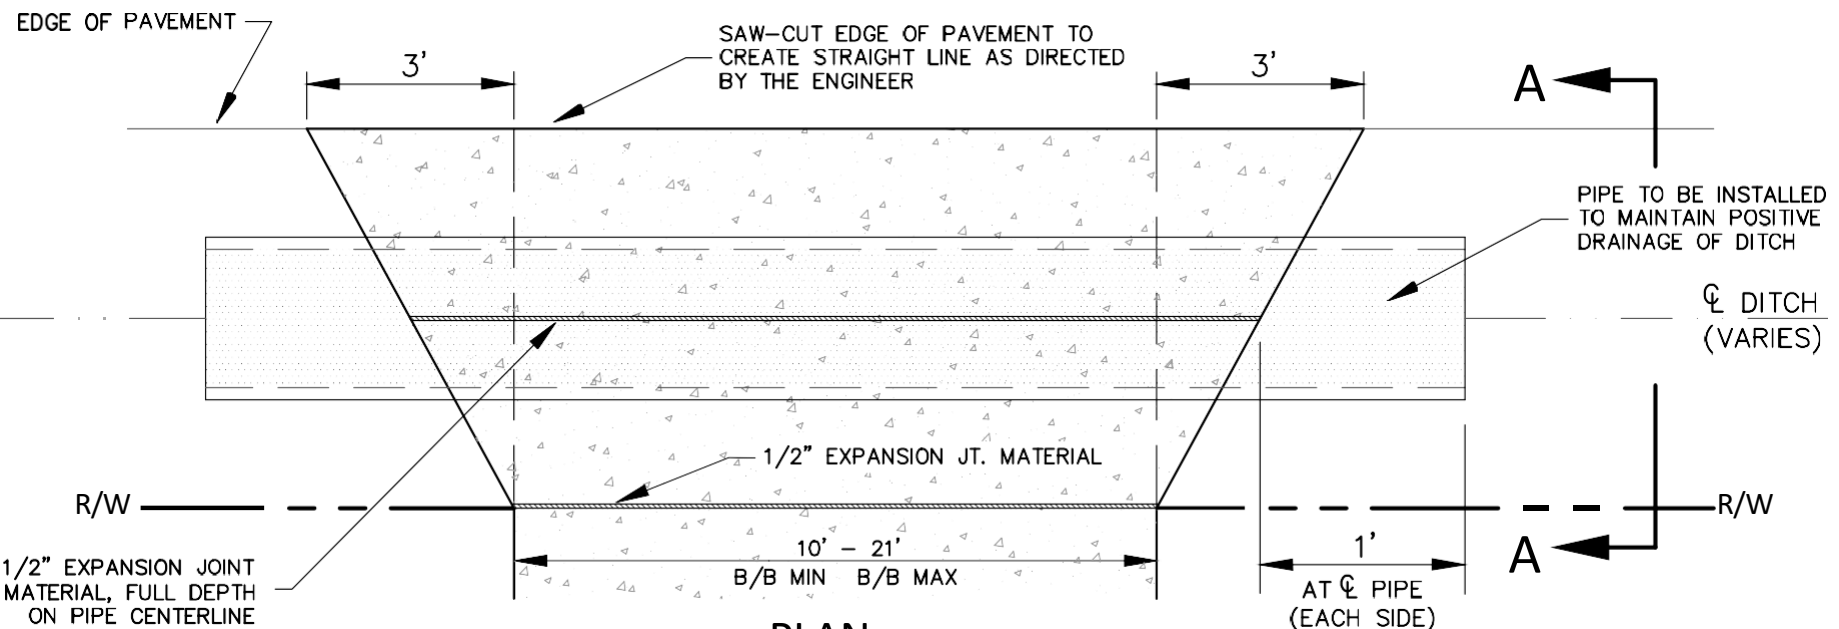

PLAN

REVISED	DATE: 8/14/2025	Standard Detail	OFFICE OF THE
	SCALE: NONE		CITY ENGINEER
	DRAWN BY: ASB, MCB		GASTONIA, N.C.
	CITY ENGINEER: JKL		FILE NO. 71D-20B2A
	CHECKED BY: JB, JKL, IB	Ribbon Paved Street Concrete Driveway Entrance Residential Drive (Ditch)	

