




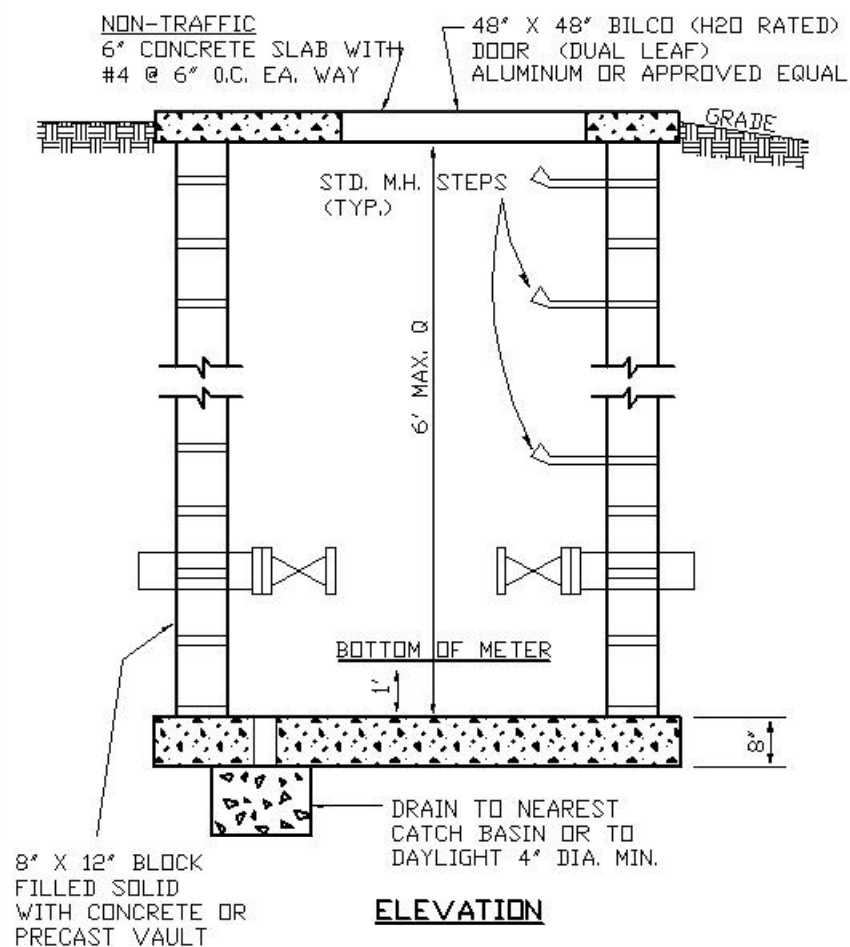

METER AND BYPASS ASSEMBLY
TO REST OF PIPE SUPPORTS -
- STANDON #S89 OR EQUAL,
3 REQUIRED

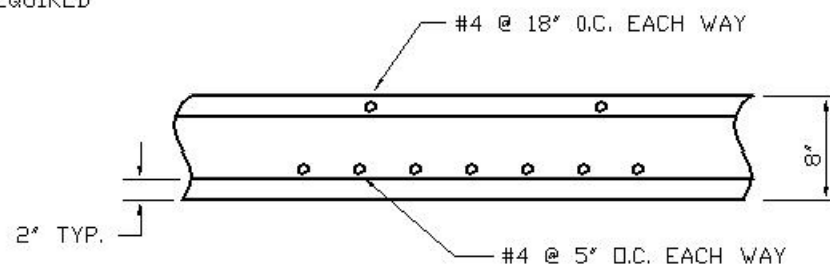

TRAFFIC LOAD BEARING SLAB

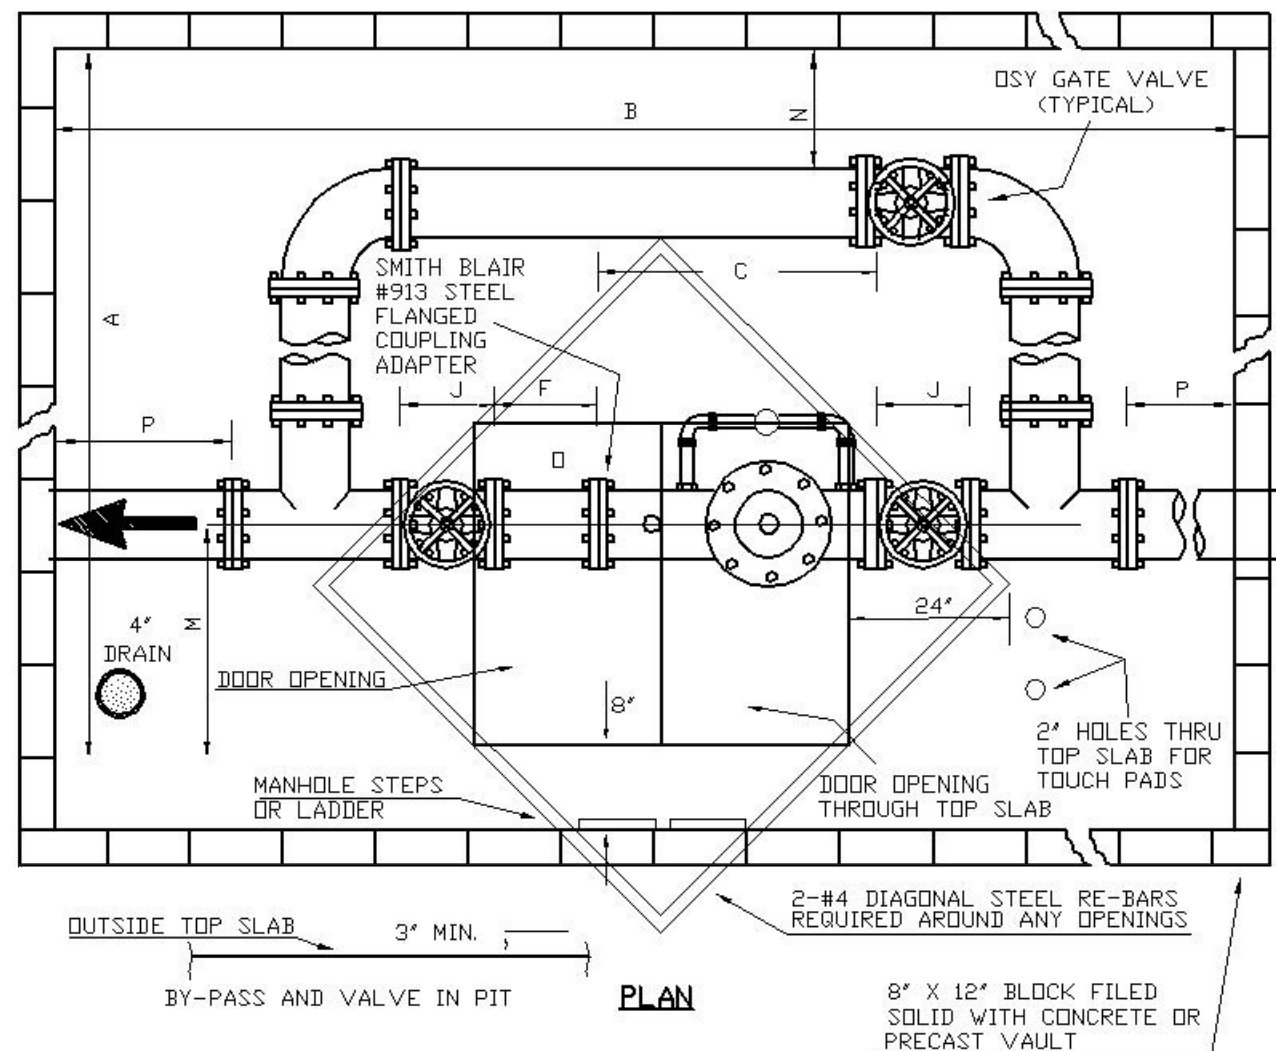

COMPOUND METER & BY-PASS LINE												
	A	B	C	F	G	H	J	M	N	O	P	Q
3	72	96	17	16	-	-	8	30	13.5	71	12	48
4	72	96	20	16	-	-	9	30	12	80	8	54
6	96	120	24	16	-	-	10.5	36	26	93	13.5	60

CONTACT UTILITIES DIVISION CONCERNING METER
INSTALLATION GREATER THAN 6"

REVISED	F.B.	PG.	DATE: 9-26-85
JWL 5/86			SCALE: NONE
2/19/88			DRAWN BY: JDH
2/6/97			CHECKED BY: FAP
DS 10/97			CITY ENGINEER: JPB
JJ 02/05			

STANDARD DETAIL

COMPOUND METER INSTALLATION

OFFICE OF THE
CITY ENGINEER
GASTONIA, N.C.

FILE
NO.

71B-10A