


NOTE: WATER METER IN ACCRDANCE WITH THE STANDARD SPECIFICATIONS FOR WATER DISTRIBUTION. ALL FITTINGS TO BE COMPRESSION JOINT TYPE AS APPROVED BY THE CITY ENGINEER.

MINIMUM TAP SPACING SHALL BE 2' O.C.

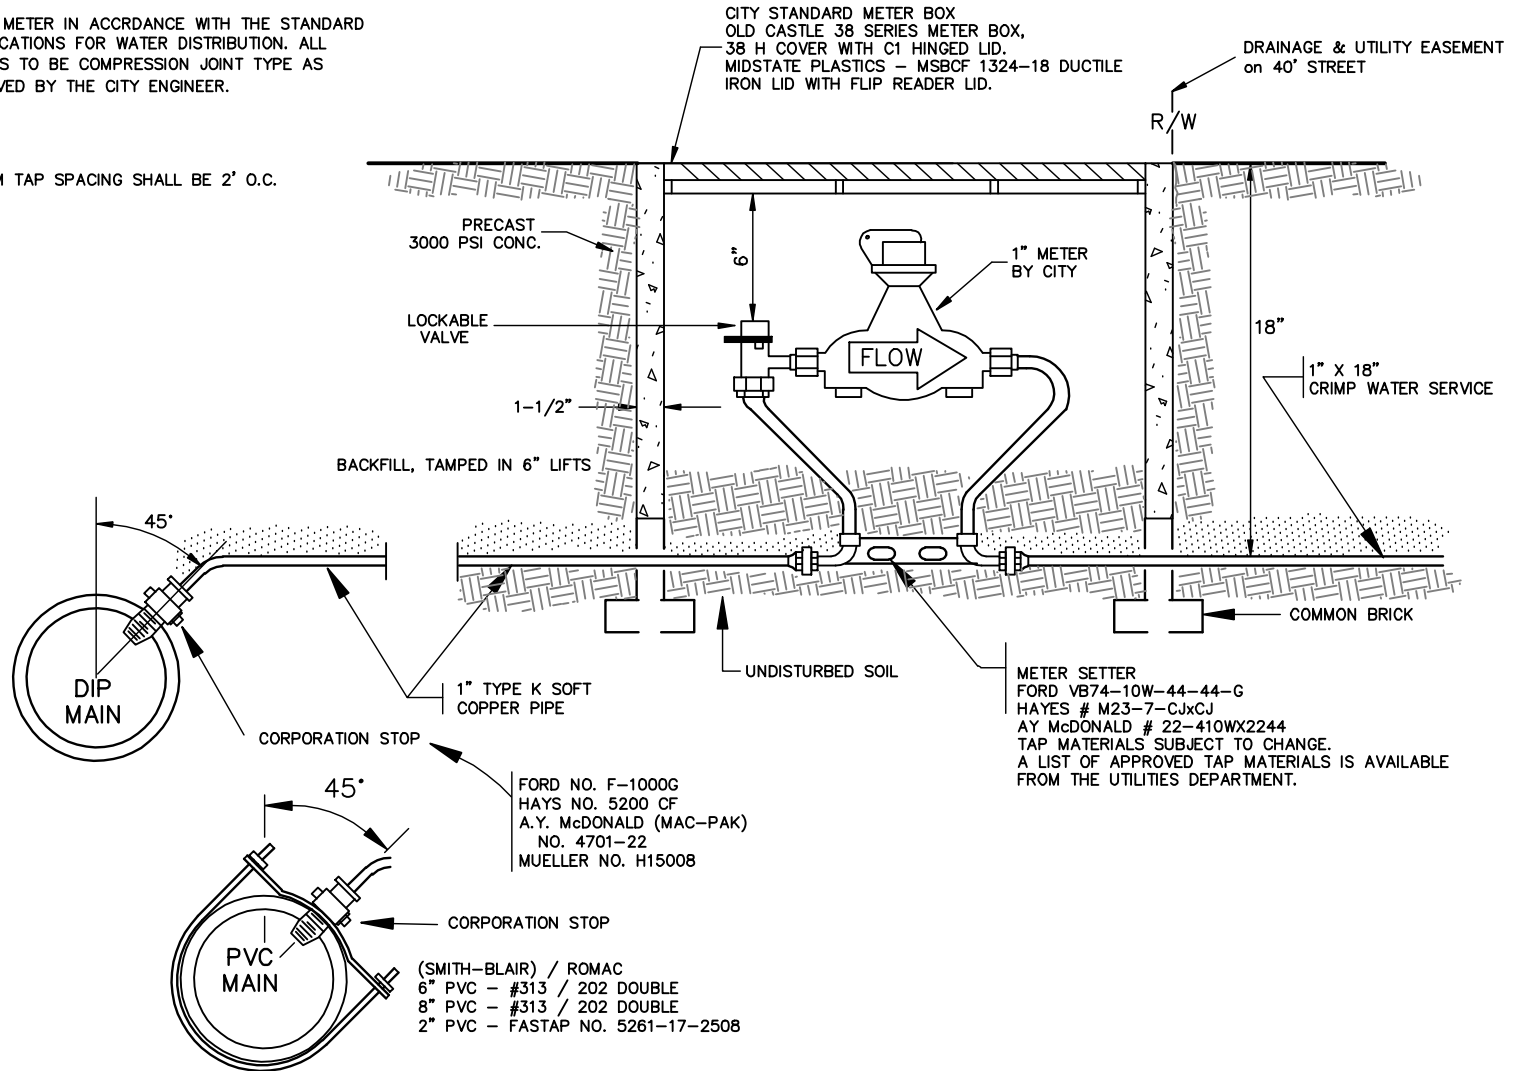

REVISED	F.B.	PG.	DATE: AUG. 14, 1984
02-02-01			SCALE: NTS
05-25-01			DRAWN BY: MLB, EZ, JJ
03-10-03			CHECKED BY: DCC, FAP
08-16-05			CITY ENGINEER: FAP
03-03-09			

**Standard Detail**  
**1" Water Tap and**  
**Meter Details**

OFFICE OF THE  
**CITY ENGINEER**  
 GASTONIA, N.C.

FILE NO. **71B-20C**