


NOTE: WATER METER IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS FOR WATER DISTRIBUTION. ALL FITTINGS TO BE COMPRESSION JOINT TYPE AS APPROVED BY THE CITY ENGINEER.

MINIMUM TAP SPACING SHALL BE 2' O.C.

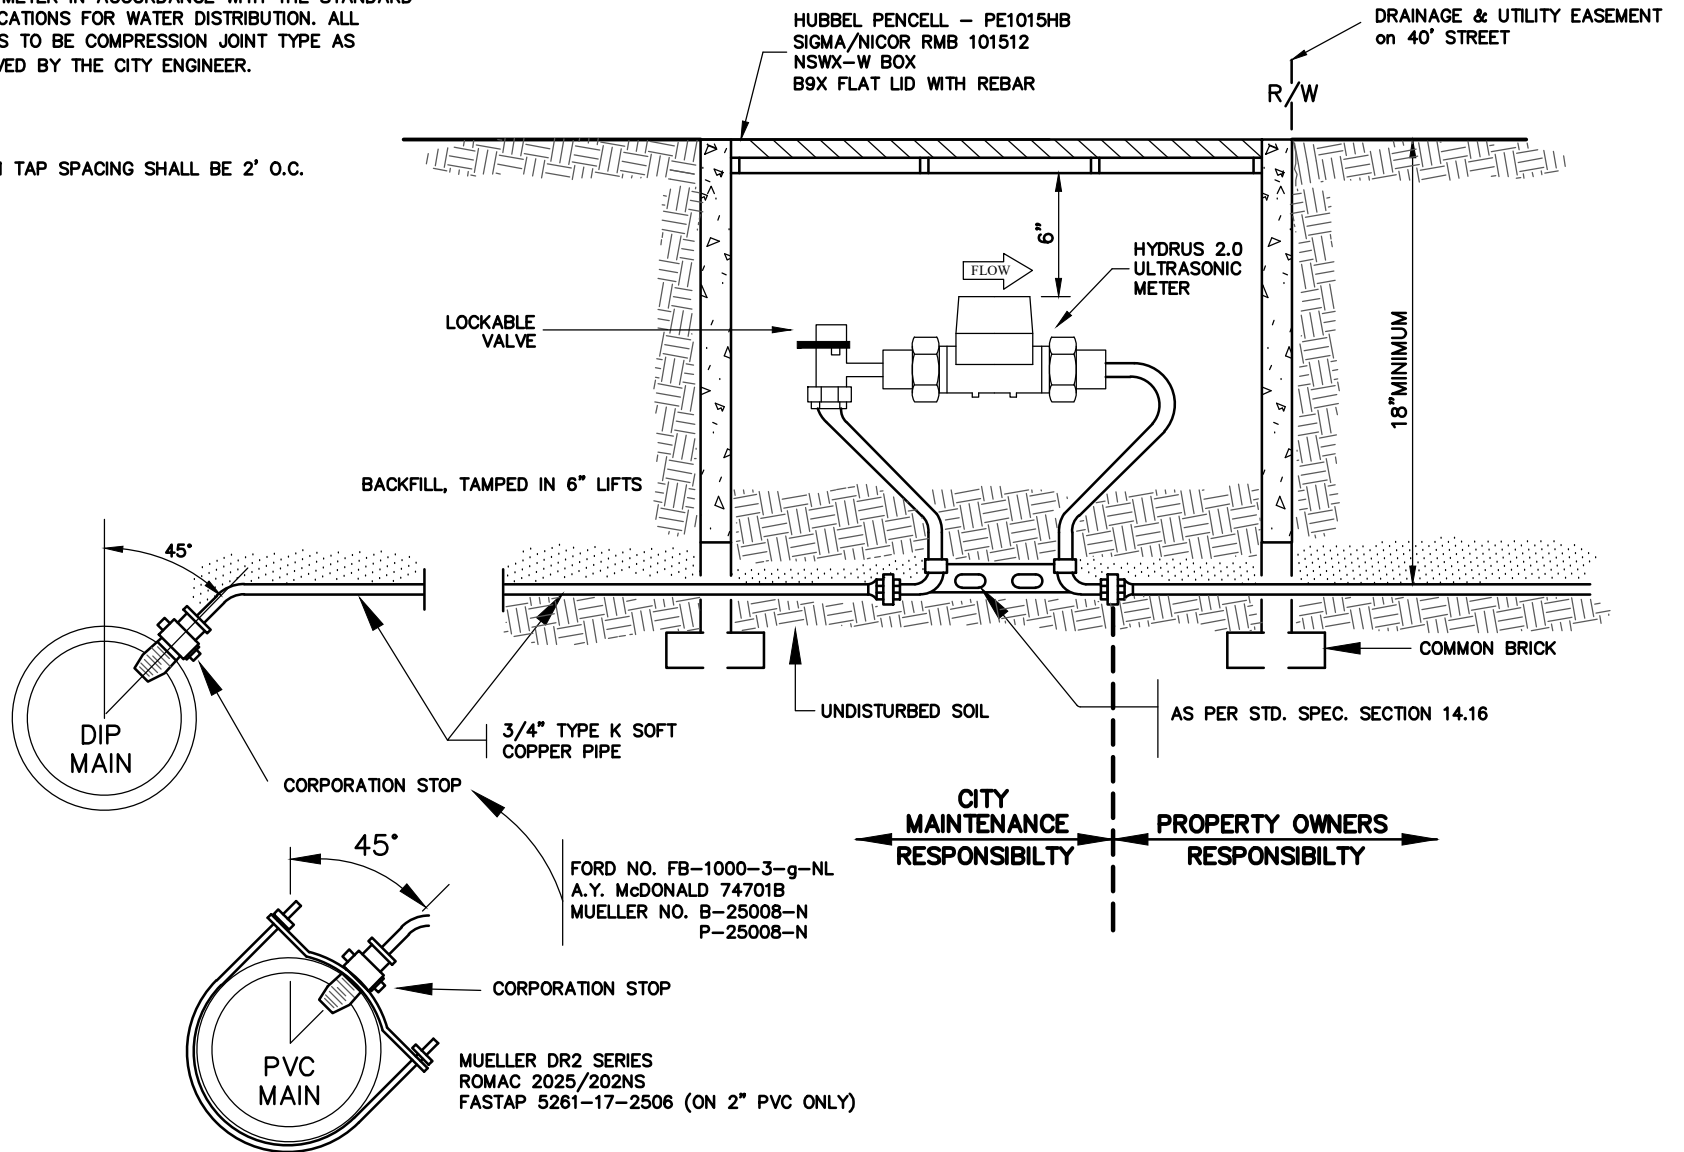

REVISED
02-02-01
05-23-01
03-10-03
03-03-09
01-09-26

F.B. PG.

DATE: AUG. 14, 1984
SCALE: NTS
DRAWN BY: MLB, EZ, JW
CHECKED BY: DCC, FAP
CITY ENGINEER: FAP

Standard Detail
3/4" x 5/8" Water Tap and
Meter Details

OFFICE OF THE
CITY ENGINEER
GASTONIA, N.C.
FILE NO. 71B-20