


NOTES:

1. TRUNCATED DOMES (BLACK) TO BE PLACED FROM BACK OF CURB TO 2 FT. FROM BACK OF CURB. SEE 71D-28.
2. THE ENTIRE CURB RAMP, FROM EXPANSION JOINT TO EXPANSION JOINT, SHALL BE 6" THICK CONCRETE.
3. RAMP TO BE CENTERED ON INTERSECTION OF CROSSWALKS.
4. SEE PAVEMENT MARKING PLANS FOR CROSSWALK TYPE AND LOCATION.


TYPICAL LOCATION DETAIL

SHEET 1 OF 2

REVISED	DATE: 05-23-19	Standard Detail	OFFICE OF THE
	SCALE: NONE		CITY ENGINEER
	DRAWN BY: MGB		GASTONIA, N.C.
	CHECKED BY: TAJ		FILE NO. 71D-27A
	CITY ENGINEER: GVS	Wheelchair Ramp Detail sidewalk Without Planter Strip	

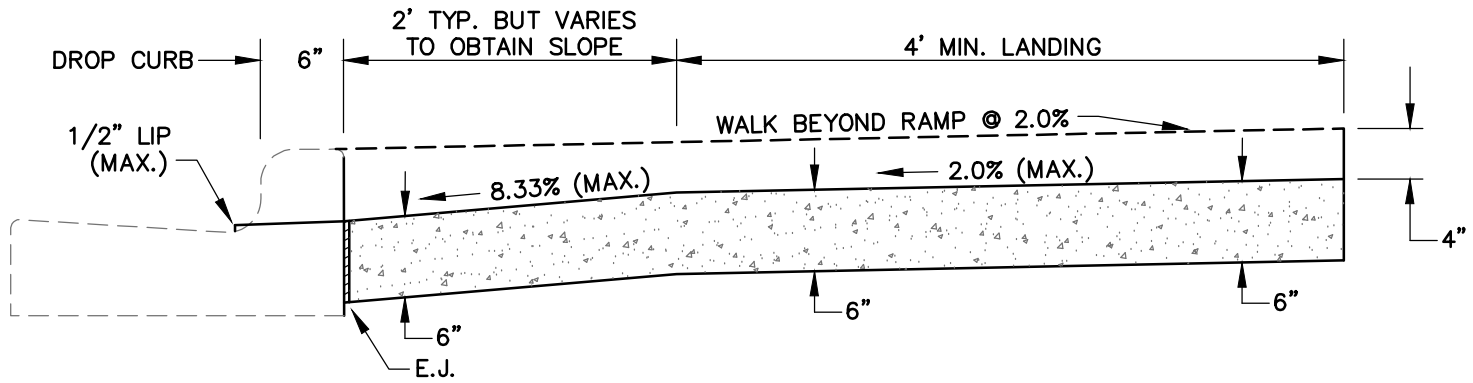

SECTION A-A

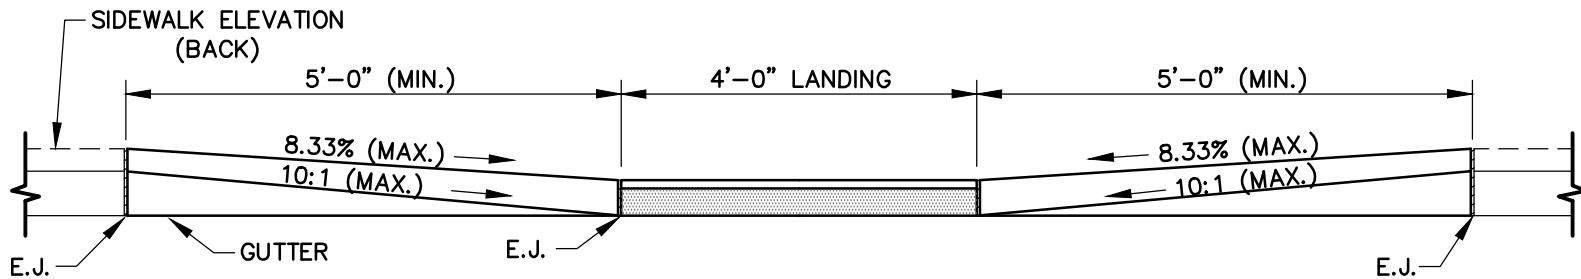

SECTION B-B

SHEET 2 OF 2

REVISED	DATE: 05-23-19	Standard Detail	OFFICE OF THE
	SCALE: NONE		CITY ENGINEER
	DRAWN BY: MGB		GASTONIA, N.C.
	CHECKED BY: TAJ		FILE NO. 71D-27A
	CITY ENGINEER: GVS	Wheelchair Ramp Detail sidewalk Without Planter Strip	